

Group Address Setting

In group mode the Multi-tone Open-area Alarm Devices responds to an additional address referred to as the group address, which is used to activate groups of sounders simultaneously. Individual units continue to respond to their own addresses and report their status in the normal way. A group address is set on a four-segment DIL switch which is factory set to 0000. A group address may be any spare address within—and only within—the range 112 to 126 inclusive. The required group address is set in accordance with the following table.

addr	DIL switch setting 1234	addr	DIL switch setting 1234	addr	DIL switch setting 1234
112	1111	117	0101	122	1010
113	0111	118	1001	123	0010
114	1011	119	0001	124	1100
115	0011	120	1110	125	0100
116	1101	121	0110	126	1000

Note: group mode is disabled if the group address DIL switch is set to 0000, irrespective of the protocol message.

Commissioning

It is important that the Multi-tone Open-area Alarm Devices be fully tested after installation. An XP95 Test Set, part no. 55000-870, may be used to carry out functional testing of individual units. The test set can also perform data integrity tests of an entire system.

Troubleshooting

Before investigating individual units for faults, it is important to check the system wiring is fault-free. Earth faults on data loops may cause communication errors.

Fault Finding

Problem	Possible Cause
No response or missing	Incorrect address setting Incorrect loop wiring (polarity reversed) Too many Sounders with Visual Indicator between isolators
Analogue value 2	Visual Indicator failed (Sounder with Visual Indicator version only)
Analogue value 4	Incorrect group or individual address setting
Device fault	Incorrect group address setting
Device fails to operate	Control panel has incorrect cause and effect programming Incorrect group address setting

Locking Mechanism

To meet the requirements of EN54 Part 3 and the Construction Products Directive, the devices have been designed to lock to its base. To release the Type A device from its base, a release key (supplied) must be used to release the latch in the side of the base. To unlock the Type B (Weatherproof) versions, a hex driver (supplied) is required.



Multi-tone Open-area Alarm Devices Installation Guide

General

This guide describes the installation of the following products:

Part No	Product Name	Type	Colour
55000-278	Multi-tone Open-area Sounder	Indoor (Type A)	Red
55000-279	Multi-tone Open-area Sounder	Indoor (Type A)	White
55000-274	Multi-tone Weatherproof Open-area Sounder	Outdoor (Type B)	Red
55000-275	Multi-tone Weatherproof Open-area Sounder	Outdoor (Type B)	White
55000-293	Multi-tone Open-area Sounder with Visual Indicator and Isolator*	Indoor (Type A)	Red
55000-294	Multi-tone Open-area Sounder with Visual Indicator and Isolator*	Indoor (Type A)	White
55000-291	Multi-tone Open-area Sounder with Visual Indicator*	Indoor (Type A)	Red
55000-292	Multi-tone Open-area Sounder with Visual Indicator*	Indoor (Type A)	White
55000-298	Multi-tone Weatherproof Open-area Sounder with Visual Indicator and Isolator*	Outdoor (Type B)	Red
55000-299	Multi-tone Weatherproof Open-area Sounder with Visual Indicator and Isolator*	Outdoor (Type B)	White
55000-296	Multi-tone Weatherproof Open-area Sounder with Visual Indicator *	Outdoor (Type B)	Red
55000-297	Multi-tone Weatherproof Open-area Sounder with Visual Indicator *	Outdoor (Type B)	White

* This is a supplementary indicator and is not to be used where a VAD is specified. This product is not EN54-23 compliant.

The Multi-tone Open-area Alarm Devices are connected to control panels which use the Discovery or XP95 protocol. It complies with the requirements of EN54-3: 2001. Versions with isolator also comply with EN54-17: 2005.

Tones incorporated in the product are:

Apollo Standard Tone, Slow Whoop Tone to NEN2575 and DIN 33404 Tone. There are 2 volume settings in each variant.

The versions which incorporate a short-circuit isolator have a yellow indicator LED, which illuminates through the lens if a short circuit is detected on the loop wiring.

Mounting the Backbox

The backbox is removed by using either an unlocking key (Type A versions) to press in one of the retaining lugs, or a hex driver (Type B versions).

The Type A product has 6 slotted knockouts on the backbox and is installed directly to the mounting surface. For the Type B product, fit the backbox to the mounting surface with four screws using the holes in each corner (see Fig 1). Do not drill through the backbox.

To ensure that there is a good seal between the back box and the unit, the mounting surface should be as flat as possible and the mounting screws not over tightened.

Wiring Details

Note: This product is polarity sensitive (supply reversal protected) and will not function if wired incorrectly.

Drill holes for cable entry as appropriate for the installation. Drill guides are marked on the backbox. To maintain the integrity of the Type B product it is essential that suitable cable glands be used.

Connect the loop cables to the terminal block, observing polarity and functional earth/screen if applicable. The wiring terminals accept solid or stranded cables up to 2.5mm².

The maximum number of Multi-tone Open-area Alarm Devices permitted between standard XP95 isolators (part no. 55000-720) or isolating bases (part no. 45681-321/284) is 20, depending on the loop loading. Apollo's Loop Calculator is a program available as a free download from www.apollo-fire.co.uk and can be used to check the loading of any proposed loop design.

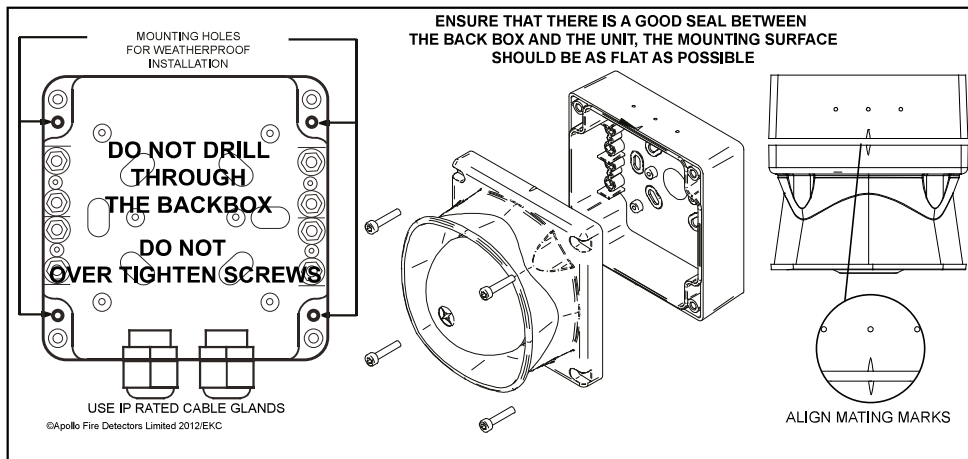


Fig 1. Mounting Type B weatherproof products

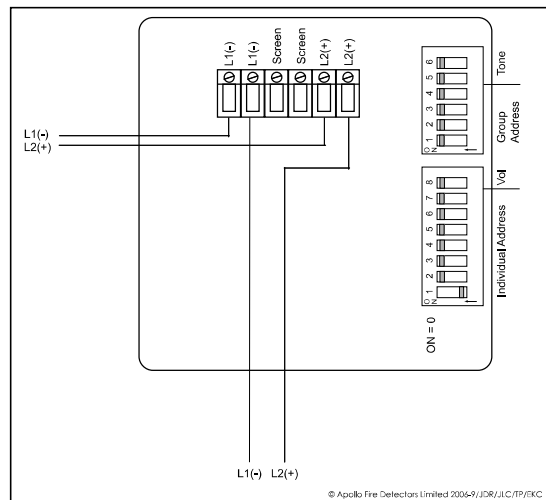


Fig 2. Wiring

Example: Individual Address 78 = 0 1 1 1 0 0 1 1
 Volume 92dB = 0 1 1 1
 Group Address 113 = 0 1 1 1
 Tone setting Standard = 0 0

ON = 0

Individual Address

Vol

Group Address

Tone

Tone Setting

5	6	Tone
0	0	Standard
1	0	Slow Whoop
0	1	DIN
1	1	Standard

The alert or evacuate mode is selected using the appropriate settings on the CIE (Control & Indicating Equipment)

© Apollo Fire Detectors Limited 2006-9/JDR/TF

Fig 3. Example of address and tone setting

Technical Data

Operating Voltage	18–28V DC
Maximum Loop Current Consumption at 24V	
Switch-on Surge	1.2mA for <1 sec
Quiescent	330µA
Sounder Operated	4mA Max
Sounder Beacon Operated: 92/100dB(A)	9mA Max
Sound Output	100dB(A)
IP Rating - Type A	21C
IP Rating - Type B	IP33C (IP66C**)

** Non EN 54 certified

For sound pressure levels measured to EN54-3 see document PP2203 and for isolator operation information see document PP2090, both available on request.

IP Rating

To maintain the integrity of the enclosure it is essential that suitable IP rated cable glands be used.

Individual Address Setting

The address of the Multi-tone Open-area Alarm Devices is set using seven segments of the eight-segment DIL switch. The eighth segment is used to adjust the volume output. Segments 1-7 of the switch are set to "0" (ON) or "1", using a small screwdriver or similar tool. A complete list of address settings is shown below.

addr	DIL switch setting 1234567	addr	DIL switch setting 1234567	addr	DIL switch setting 1234567	addr	DIL switch setting 1234567	addr	DIL switch setting 1234567
1	1000000	11	1101000	21	1010100	31	1111100	41	1001010
2	0100000	12	0011000	22	0110100	32	0000010	42	0101010
3	1100000	13	1011000	23	1110100	33	1000010	43	1101010
4	0010000	14	0111000	24	0001100	34	0100010	44	0011010
5	1010000	15	1111000	25	1001100	35	1100010	45	1011010
6	0110000	16	0000100	26	0101100	36	0010010	46	0111010
7	1110000	17	1000100	27	1101100	37	1010010	47	1111010
8	0001000	18	0100100	28	0011100	38	0110010	48	0000110
9	1001000	19	1100100	29	1011100	39	1110010	49	1000110
10	0101000	20	0010100	30	0111100	40	0001010	50	0100110
51	1100110	61	1011110	71	1110001	81	1000101	91	1101101
52	0010110	62	0111110	72	0001001	82	0100101	92	0011101
53	1010110	63	1111110	73	1001001	83	1100101	93	1011101
54	0110110	64	0000001	74	0101001	84	0010101	94	0111101
55	1110110	65	1000001	75	1101001	85	1010101	95	1111101
56	0001110	66	0100001	76	0011001	86	0110101	96	0000011
57	1001110	67	1100001	77	1011001	87	1110101	97	1000011
58	0101110	68	0010001	78	0111001	88	0001101	98	0100011
59	1101110	69	1010001	79	1111001	89	1001101	99	1100011
60	0011110	70	0110001	80	0000101	90	0101101	100	0010011
101	1010011	106	0101011	111	1111011	116	0010111	121	1001111
102	0110011	107	1101011	112	0000111	117	1010111	122	0101111
103	1110011	108	0011011	113	1000111	118	0110111	123	1101111
104	0001011	109	1011011	114	0100111	119	1110111	124	0011111
105	1001011	110	0111011	115	1100111	120	0001111	125	1011111
								126	0111111